

JOB NAME _____ LOCATION _____
 PURCHASER _____ ORDER NO. _____
 ENGINEER _____
 SUBMITTED TO _____ FOR: Reference Approval Construction
 SUBMITTED BY _____ DATE _____

UNIT DESIGNATION: Schedule No. _____ MODEL NO. _____

PRODUCT DATA

COOLING PERFORMANCE

TOTAL CAPACITY ___ MBH
 OUTDOOR DESIGN TEMP. ___ °F
 SUCT. PRESS. AT SATURATION ___ PSIG
 SUCT. TEMP. AT SATURATION. ___ °F


ELECTRICAL DATA

POWER SUPPLY / /
 TOTAL UNIT AMPACITY ___ AMPS
 POWER INPUT REQUIREMENT ___ KW
 MAXIMUM FUSE SIZE ___ AMPS
 (Dual Element)

UNIT WEIGHT

TOTAL OPERATING WEIGHT ___ LBS.

DIMENSIONS - INCHES

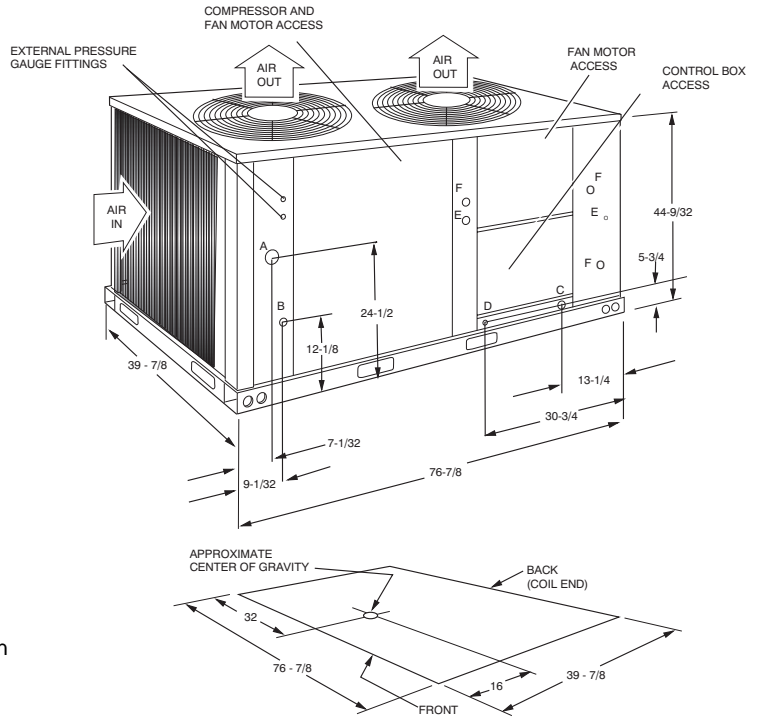

Connection Entry		Connection Size	
		15 Ton	20 Ton
Suction Line	A	1-5/8 OD	2-1/8 OD
Liquid Line	B	5/8 OD	5/8 OD
Power Wiring	C	2-1/8 KO	2-1/8 KO
Control Wiring	D	7/8 KO	7/8 KO
Accessory Wiring	E	7/8 KO	7/8 KO
Accessory Wiring	F	1-3/8 KO	1-3/8 KO

FEATURES:

- High Efficiency
- UL listed to US and Canadian Standards
- Dual Hermetic Scroll Compressors with Capacity Reduction
- Propeller-Type Condenser Fans
- Inherently Protected Fan Motors with Ball Bearings
- Low Ambient to 35°F
- Anti-Cycle Protection
- Refrigerant-22 Holding Charge
- 24 Volt Temperature Control Circuit
- Crankcase Heaters
- Copper Tube/Aluminum Fin Coil
- Exterior Service Port Connections
- Base Rails with Forklift Slots
- High, Low Pressure Controls
- Backseating Suction and Liquid Line Service Valves
- Filter-Drier Supplied for Field Installation
- 1-Year Limited Parts Warranty on Complete Unit with additional four-year Warranty on the Compressor.

FIELD INSTALLED ACCESSORIES:

- 0° Low Ambient Controls
- Decorative Coil Guard
- Phenolic Coating on Condenser Coil

MATCHING AIR SIDE EQUIPMENT:

Model No. (_____)
 Submittal Form No. (_____)

CLEARANCES

Overhead (Top) ¹	120 in.
Front (Piping & Access Panels)	30 in.
Left Side	24 in.
Right Side	24 in.
Rear	24 in.
Bottom ²	0 in.

¹Units must be installed outdoors. Overhanging structures or shrubs should not obstruct condenser air discharge.
²Adequate snow clearance must be provided if winter operation is expected.

NOTES: _____

Refer to form 550.23-TG3Y for detailed specifications on the unit and its accessories. Subject to change without notice. Printed in the U. S. A.

SPLIT-SYSTEM CONDENSING UNITS
 MODELS H_CE180 & H_CE240
 15 & 20 TONS

FORM 550.23-SD3Y (498)

Supersedes: 550.23-SD3Y (398)

